


U.S. CLIMATE ZONES for C.I. REQUIREMENTS

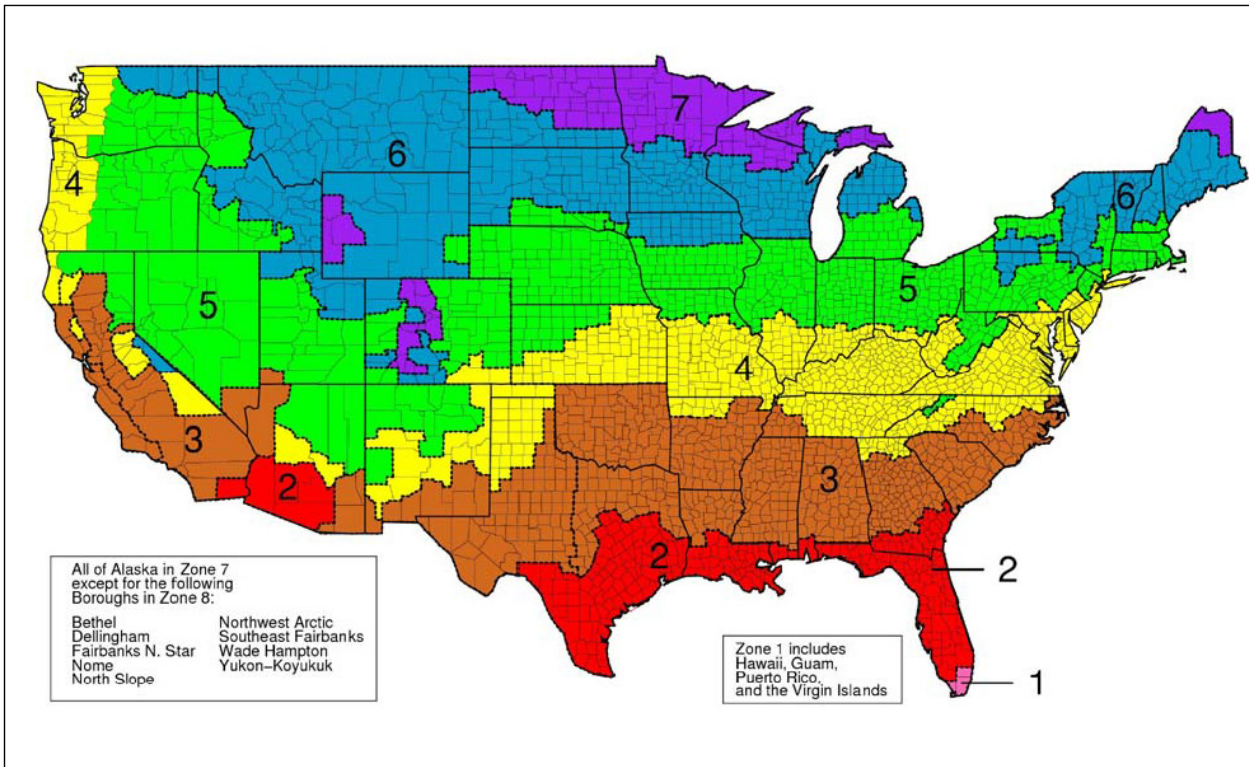

GENERAL R-VALUE REQUIREMENTS FOR U.S. CLIMATE ZONES COMMERCIAL BUILDINGS WITH WOOD FRAMING

ASHRAE 90.1-2010 Code Requirements

ZONE 1 -	R-13.0 / NR	or	R-20
ZONE 2 -	R-13.0 / NR	or	R-20
ZONE 3 -	R-13.0 / NR	or	R-20
ZONE 4 -	R-13.0 / NR	or	R-20
ZONE 5 -	R-13.0 / R-3.8 c.i.	or	R-20
ZONE 6 -	R-13.0 / R-7.5 c.i.	or	R-20 / R-3.8 c.i.
ZONE 7 -	R-13.0 / R-7.5 c.i.	or	R-20 / R-3.8 c.i.
ZONE 8 -	R-13.0 / R15.6 c.i.	or	R-20 / R-10 c.i.

c.i. = CONTINUOUS INSULATION, NR = NO (INSULATION) REQUIRED

IBC 2012 Code Requirements

ZONE 1 -	R-13.0 / R-3.8 c.i.	or	R-20 / NR
ZONE 2 -	R-13.0 / R-3.8 c.i.	or	R-20 / NR
ZONE 3 -	R-13.0 / R-3.8 c.i.	or	R-20 / NR
ZONE 4 -	R-13.0 / R-3.8 c.i.	or	R-20 / NR
ZONE 5 -	R-13.0 / R-3.8 c.i.	or	R-20 / NR
ZONE 6 -	R-13.0 / R-7.5 c.i.	or	R-20 / R-3.8 c.i.
ZONE 7 -	R-13.0 / R-7.5 c.i.	or	R-20 / R-3.8 c.i.
ZONE 8 -	R-13.0 / R15.6 c.i.	or	R-20 / R-10 c.i.

c.i. = CONTINUOUS INSULATION, NR = NO (INSULATION) REQUIRED

To view your states specific compliance regulations visit:
<http://www.energycodes.gov/compliance>